



Ref. Certif. No.

FR\_705078/M1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Residual current operated circuit-breakers without integral overcurrent protection for household and similar uses (RCCB's)

Name and address of the applicant

LEGRAND FRANCE  
159 RUE JEAN JOANNON - ZI DES TROIS MOULINS  
06606 ANTIBES - FRANCE

Name and address of the manufacturer

LEGRAND FRANCE  
159 RUE JEAN JOANNON - ZI DES TROIS MOULINS  
06606 ANTIBES - FRANCE

Name and address of the factory

Note: When more than one factory, please report on page 2

Additional Information on page 2

Ratings and principal characteristics

See Annex

Trademark / Brand (if any)



Customer's Testing Facility (CTF) Stage used

CTF2

Model / Type Ref.

RCCB 4P  
Series TX<sup>3</sup>, XC<sup>3</sup>, XC10, RX<sup>3</sup>, DX<sup>3</sup>  
References : see annex

Additional information (if necessary may also be reported on page 2)

Supersedes CBTC FR\_705078/A1 dated 2022/10/10. Addition of product references

Additional Information on page 2

A sample of the product was tested and found to be in conformity with

IEC 61008-1:2010 +A1:2012 +A2:2013  
IEC 61008-2-1:1990

As shown in the Test Report Ref. No. which forms part of this Certificate

154382-718396, 154382-718396/1 to 154382-718396/39, 13437609-775591-A, 13437609-775591-A1 to 13437609-775591-A7 18446261-787692, 18446261-787692/1 and 18446261-787692/2

This CB Test Certificate is issued by the National Certification Body



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES  
S.A.S au capital de 15.745.984 €  
RCS Nanterre B 409 863 174  
33 avenue du Général Leclerc  
F - 92266 FONTENAY AUX ROSES

Signature:   
Julien GAUTHIER  
Certification Officer

## ANNEX

**Name and address of the factories:**

**LEGRAND FRANCE**  
290 AVENUE DE COLMAR  
67100 STRASBOURG  
FRANCE

**LEGRAND FRANCE**  
159 RUE JEAN JOANNON  
ZI DES TROIS MOULINS  
06606 ANTIBES  
FRANCE

**LEGRAND ELEKTRIK SANAYI A.S**  
GOSB GEBZE ORGANIZE SANAYI BOLGESI  
IHSAN DEDE CADDESI N°112  
41480 GEBZE KOCAELI  
TURKEY


**M/S NOVATEUR ELECTRICAL AND DIGITAL SYSTEMS PRIVATE LIMITED**  
UNIT-II, BLOCK-A, B & D / UNIT-III, BLOCK C, Plot No-2, Sector-2, IIE, SIDCUL  
HARIDWAR - 249402  
UTTRAKHAND  
INDIA

**NOVATEUR ELECTRICAL AND DIGITAL SYSTEMS PRIVATE LIMITED**  
D-4 MIDC INDUSTRIAL AREA, AJANTHA ROAD  
JALGAON - 425003  
MAHARASHTRA  
INDIA



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

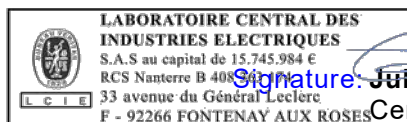

Signature:  **Julien GAUTHIER**  
Certification Officer



Ref. Certif. No.  
**FR\_705078/M1**

**ANNEX**

**REFERENCES, RATINGS AND MAIN CHARACTERISTICS**


**TX<sup>3</sup> "Germanique" series**

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 07	25 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4117 08	40 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4117 09	63 A	400V~	right	30 mA	AC	630 A	1000 A	10000A	10000A
4117 10	80 A	400V~	right	30 mA	AC	800 A	1000 A	10000A	10000A
LG1293	100 A	400V~	right	30 mA	AC	1000 A	1000 A	10000A	10000A
4117 17	25 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4117 18	40 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4117 19	63 A	400V~	right	100 mA	AC	630 A	1000 A	10000A	10000A
4117 20	80 A	400V~	right	100 mA	AC	800 A	1000 A	10000A	10000A
LG1294	100 A	400V~	right	100 mA	AC	1000 A	1000 A	10000A	10000A
4117 27	25 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4117 28	40 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4117 29	63 A	400V~	right	300 mA	AC	630 A	1000 A	10000A	10000A
4117 30	80 A	400V~	right	300 mA	AC	800 A	1000 A	10000A	10000A
LG1295	100 A	400V~	right	300 mA	AC	1000 A	1000 A	10000A	10000A
4117 37	25 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
4117 38	40 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
4117 39	63 A	400V~	right	500 mA	AC	630 A	1000 A	10000A	10000A
4117 40	80 A	400V~	right	500 mA	AC	800 A	1000 A	10000A	10000A
LG1296	100 A	400V~	right	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

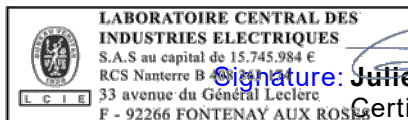

Signature: **Julien GAUTHIER**  
Certification Officer

## ANNEX (continued)

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 64 4119 31	25 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4117 65 4119 32	40 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4117 66 4119 33	63 A	400V~	right	30 mA	A	630 A	1000 A	10000A	10000A
4117 67	80 A	400V~	right	30 mA	A	800 A	1000 A	10000A	10000A
4117 68	100 A	400V~	right	30 mA	A	1000 A	1000 A	10000A	10000A
4117 74 4119 36	25 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
4117 75 4119 37	40 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
4117 76 4119 38	63 A	400V~	right	100 mA	A	630 A	1000 A	10000A	10000A
4117 77	80 A	400V~	right	100 mA	A	800 A	1000 A	10000A	10000A
4117 78	100 A	400V~	right	100 mA	A	1000 A	1000 A	10000A	10000A
4117 84	25 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
4117 85 4119 42	40 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
4117 86 4119 43	63 A	400V~	right	300 mA	A	630 A	1000 A	10000A	10000A
4117 87	80 A	400V~	right	300 mA	A	800 A	1000 A	10000A	10000A
4117 88	100 A	400V~	right	300 mA	A	1000 A	1000 A	10000A	10000A
4117 94	25 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
4117 95	40 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
4117 96	63 A	400V~	right	500 mA	A	630 A	1000 A	10000A	10000A
4117 97	80 A	400V~	right	500 mA	A	800 A	1000 A	10000A	10000A
4117 98	100 A	400V~	right	500 mA	A	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
 INDUSTRIES ELECTRIQUES  
 S.A.S au capital de 15.745.984 €  
 RCS Nanterre B 408 363 174  
 33 avenue du Général Leclerc  
 F - 92266 FONTENAY AUX ROSES

Signature:   
**Julien GAUTHIER**  
 Certification Officer


**ANNEX (continued)**

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1309	25 A	400V~	right	100 mA	AC-S	500 A	1000 A	10000A	10000A
4117 42	40 A	400V~	right	100 mA	AC-S	500 A	1000 A	10000A	10000A
4117 43	63 A	400V~	right	100 mA	AC-S	630 A	1000 A	10000A	10000A
LG1310	80 A	400V~	right	100 mA	AC-S	800 A	1000 A	10000A	10000A
LG1311	100 A	400V~	right	100 mA	AC-S	1000 A	1000 A	10000A	10000A
LG1312	25 A	400V~	right	300 mA	AC-S	500 A	1000 A	10000A	10000A
4117 48	40 A	400V~	right	300 mA	AC-S	500 A	1000 A	10000A	10000A
4117 49	63 A	400V~	right	300 mA	AC-S	630 A	1000 A	10000A	10000A
LG1313	80 A	400V~	right	300 mA	AC-S	800 A	1000 A	10000A	10000A
LG1314	100 A	400V~	right	300 mA	AC-S	1000 A	1000 A	10000A	10000A
LG1315	25 A	400V~	right	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG1316	40 A	400V~	right	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG1317	63 A	400V~	right	500 mA	AC-S	630 A	1000 A	10000A	10000A
LG1318	80 A	400V~	right	500 mA	AC-S	800 A	1000 A	10000A	10000A
LG1319	100 A	400V~	right	500 mA	AC-S	1000 A	1000 A	10000A	10000A
Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4119 51	25 A	400V~	right	100 mA	A-S	500 A	1000 A	10000A	10000A
4119 52	40 A	400V~	right	100 mA	A-S	500 A	1000 A	10000A	10000A
4119 53	63 A	400V~	right	100 mA	A-S	630 A	1000 A	10000A	10000A
LG1304	80 A	400V~	right	100 mA	A-S	800 A	1000 A	10000A	10000A
LG1305	100 A	400V~	right	100 mA	A-S	1000 A	1000 A	10000A	10000A
4118 03	25 A	400V~	right	300 mA	A-S	500 A	1000 A	10000A	10000A
4118 04	40 A	400V~	right	300 mA	A-S	500 A	1000 A	10000A	10000A
4119 47	63 A	400V~	right	300 mA	A-S	630 A	1000 A	10000A	10000A
4118 05	80 A	400V~	right	300 mA	A-S	800 A	1000 A	10000A	10000A
4119 48	100 A	400V~	right	300 mA	A-S	1000 A	1000 A	10000A	10000A
4118 06	25 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
LG1306	40 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
4118 07	63 A	400V~	right	500 mA	A-S	630 A	1000 A	10000A	10000A
4118 08	80 A	400V~	right	500 mA	A-S	800 A	1000 A	10000A	10000A
4118 09	100 A	400V~	right	500 mA	A-S	1000 A	1000 A	10000A	10000A
LG1307	25 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
4118 07	40 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
4118 08	63 A	400V~	right	500 mA	A-S	630 A	1000 A	10000A	10000A
4118 09	80 A	400V~	right	500 mA	A-S	800 A	1000 A	10000A	10000A
LG1308	100 A	400V~	right	500 mA	A-S	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



Signature: **Julien GAUTHIER**  
Certification Officer

## ANNEX (continued)


Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1297	25 A	400V~	right	30 mA	AC*	500 A	1000 A	10000A	10000A
4117 52	40 A	400V~	right	30 mA	AC*	500 A	1000 A	10000A	10000A
4117 53	63 A	400V~	right	30 mA	AC*	630 A	1000 A	10000A	10000A
LG1298	80 A	400V~	right	30 mA	AC*	800 A	1000 A	10000A	10000A
LG2732	100 A	400V~	right	30 mA	AC*	1000 A	1000 A	10000A	10000A
LG1299	25 A	400V~	right	100 mA	AC*	500 A	1000 A	10000A	10000A
4117 56	40 A	400V~	right	100 mA	AC*	500 A	1000 A	10000A	10000A
4117 57	63 A	400V~	right	100 mA	AC*	630 A	1000 A	10000A	10000A
LG1300	80 A	400V~	right	100 mA	AC*	800 A	1000 A	10000A	10000A
LG2734	100 A	400V~	right	100 mA	AC*	1000 A	1000 A	10000A	10000A
LG2736	25 A	400V~	right	300 mA	AC*	500 A	1000 A	10000A	10000A
LG2737	40 A	400V~	right	300 mA	AC*	500 A	1000 A	10000A	10000A
LG2738	63 A	400V~	right	300 mA	AC*	630 A	1000 A	10000A	10000A
LG2739	80 A	400V~	right	300 mA	AC*	800 A	1000 A	10000A	10000A
LG2740	100 A	400V~	right	300 mA	AC*	1000 A	1000 A	10000A	10000A

\* RCCB's dedicated to Austria market



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

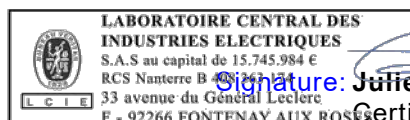

Signature: *Julien GAUTHIER*  
**Julien GAUTHIER**  
 Certification Officer


## ANNEX (continued)

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7245	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7246	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7247	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG7248	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG7249	100 A	400V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A
LG7250	25 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG7251	40 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG7252	63 A	400V~	left	100 mA	AC	630 A	1000 A	10000A	10000A
LG7253	80 A	400V~	left	100 mA	AC	800 A	1000 A	10000A	10000A
LG7254	100 A	400V~	left	100 mA	AC	1000 A	1000 A	10000A	10000A
LG7255	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7256	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7257	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
LG7258	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG7259	100 A	400V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A
LG7260	25 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG7261	40 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG7262	63 A	400V~	left	500 mA	AC	630 A	1000 A	10000A	10000A
LG7263	80 A	400V~	left	500 mA	AC	800 A	1000 A	10000A	10000A
LG7264	100 A	400V~	left	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

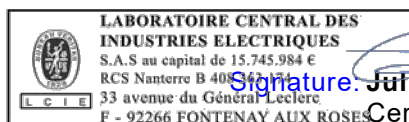

Signature: *Julien GAUTHIER*  
 Certification Officer

## ANNEX (continued)

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG2701	25 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG2702	40 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG2703	63 A	400V~	left	30 mA	A	630 A	1000 A	10000A	10000A
LG2704	80 A	400V~	left	30 mA	A	800 A	1000 A	10000A	10000A
LG2705	100 A	400V~	left	30 mA	A	1000 A	1000 A	10000A	10000A
LG2707	25 A	400V~	left	100 mA	A	500 A	1000 A	10000A	10000A
LG2708	40 A	400V~	left	100 mA	A	500 A	1000 A	10000A	10000A
LG2709	63 A	400V~	left	100 mA	A	630 A	1000 A	10000A	10000A
LG2710	80 A	400V~	left	100 mA	A	800 A	1000 A	10000A	10000A
LG2711	100 A	400V~	left	100 mA	A	1000 A	1000 A	10000A	10000A
LG2713	25 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG2714	40 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG2715	63 A	400V~	left	300 mA	A	630 A	1000 A	10000A	10000A
LG2716	80 A	400V~	left	300 mA	A	800 A	1000 A	10000A	10000A
LG2717	100 A	400V~	left	300 mA	A	1000 A	1000 A	10000A	10000A
LG2719	25 A	400V~	left	500 mA	A	500 A	1000 A	10000A	10000A
LG2720	40 A	400V~	left	500 mA	A	500 A	1000 A	10000A	10000A
LG2721	63 A	400V~	left	500 mA	A	630 A	1000 A	10000A	10000A
LG2722	80 A	400V~	left	500 mA	A	800 A	1000 A	10000A	10000A
LG2723	100 A	400V~	left	500 mA	A	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
 INDUSTRIES ELECTRIQUES  
 S.A.S au capital de 15.745.984 €  
 RCS Nanterre B 408.363.174  
 33 avenue du Général Leclerc  
 F - 92266 FONTENAY AUX ROSES

Signature:  **Julien GAUTHIER**  
 Certification Officer




## ANNEX (continued)

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7265	25 A	400V~	left	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG7266	40 A	400V~	left	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG7267	63 A	400V~	left	100 mA	AC-S	630 A	1000 A	10000A	10000A
LG7268	80 A	400V~	left	100 mA	AC-S	800 A	1000 A	10000A	10000A
LG7269	100 A	400V~	left	100 mA	AC-S	1000 A	1000 A	10000A	10000A
LG7270	25 A	400V~	left	300 mA	AC-S	500 A	1000 A	10000A	10000A
LG7271	40 A	400V~	left	300 mA	AC-S	500 A	1000 A	10000A	10000A
LG7272	63 A	400V~	left	300 mA	AC-S	630 A	1000 A	10000A	10000A
LG7273	80 A	400V~	left	300 mA	AC-S	800 A	1000 A	10000A	10000A
LG7274	100 A	400V~	left	300 mA	AC-S	1000 A	1000 A	10000A	10000A
LG7275	25 A	400V~	left	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG7276	40 A	400V~	left	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG7277	63 A	400V~	left	500 mA	AC-S	630 A	1000 A	10000A	10000A
LG7278	80 A	400V~	left	500 mA	AC-S	800 A	1000 A	10000A	10000A
LG7279	100 A	400V~	left	500 mA	AC-S	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

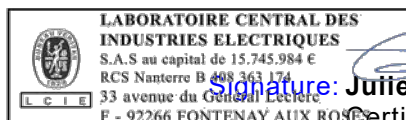

Signature: *Julien GAUTHIER*  
 Certification Officer



Ref. Certif. No.  
**FR\_705078/M1**

**ANNEX (continued)**

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7295	25 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7296	40 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7297	63 A	220/380V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG7298	80 A	220/380V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG7299	100 A	220/380V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A

LG7300	25 A	220/380V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7301	40 A	220/380V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7302	63 A	220/380V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
LG7303	80 A	220/380V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG7304	100 A	220/380V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A

Reference TX <sup>3</sup> « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7305	25 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7306	40 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7307	63 A	220/380V~	left	30 mA	A	630 A	1000 A	10000A	10000A
LG7308	80 A	220/380V~	left	30 mA	A	800 A	1000 A	10000A	10000A
LG7309	100 A	220/380V~	left	30 mA	A	1000 A	1000 A	10000A	10000A


LG7310	25 A	220/380V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG7311	40 A	220/380V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG7312	63 A	220/380V~	left	300 mA	A	630 A	1000 A	10000A	10000A
LG7313	80 A	220/380V~	left	300 mA	A	800 A	1000 A	10000A	10000A
LG7314	100 A	220/380V~	left	300 mA	A	1000 A	1000 A	10000A	10000A

These products are dedicated to brazilian and mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

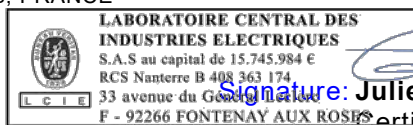

Signature: **Julien GAUTHIER**  
Certification Officer

## ANNEX (continued)

Reference	In	Un	Neutral position	I $\Delta$ n	Type	I $m$	I $\Delta$ m	I $n$ c	I $\Delta$ c
<b>TX<sup>3</sup> "Germanique other range"</b>									
LG7614	25 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
LG7615	40 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
LG7616	63 A	400V~	right	30 mA	AC	630 A	1000 A	10000A	10000A
LG7617	80 A	400V~	right	30 mA	AC	800 A	1000 A	10000A	10000A
LG7618	100 A	400V~	right	30 mA	AC	1000 A	1000 A	10000A	10000A
LG7619	25 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
LG7620	40 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
LG7621	63 A	400V~	right	300 mA	AC	630 A	1000 A	10000A	10000A
LG7622	80 A	400V~	right	300 mA	AC	800 A	1000 A	10000A	10000A
LG7623	100 A	400V~	right	300 mA	AC	1000 A	1000 A	10000A	10000A
LG7624	25 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
LG7625	40 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
LG7626	63 A	400V~	right	30 mA	A	630 A	1000 A	10000A	10000A
LG7627	80 A	400V~	right	30 mA	A	800 A	1000 A	10000A	10000A
LG7628	100 A	400V~	right	30 mA	A	1000 A	1000 A	10000A	10000A
LG7629	25 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG7630	40 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG7631	63 A	400V~	right	300 mA	A	630 A	1000 A	10000A	10000A
LG7632	80 A	400V~	right	300 mA	A	800 A	1000 A	10000A	10000A
LG7633	100 A	400V~	right	300 mA	A	1000 A	1000 A	10000A	10000A
LG7634	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7635	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7636	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG7637	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG7638	100 A	400V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A
LG7639	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7640	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG7641	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
LG7642	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG7643	100 A	400V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



Signature: **Julien GAUTHIER**  
 Certification Officer


## ANNEX (continued)

Reference	In	Un	Neutral position	I $\Delta$ n	Type	I $\Delta$ m	I $\Delta$ m	I $\Delta$ c	I $\Delta$ c
TX <sup>3</sup> "Germanique other range"									
LG7644	25 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7645	40 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7646	63 A	400V~	left	30 mA	A	630 A	1000 A	10000A	10000A
LG7647	80 A	400V~	left	30 mA	A	800 A	1000 A	10000A	10000A
LG7648	100 A	400V~	left	30 mA	A	1000 A	1000 A	10000A	10000A
LG7649	25 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG7650	40 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
LG7651	63 A	400V~	left	300 mA	A	630 A	1000 A	10000A	10000A
LG7652	80 A	400V~	left	300 mA	A	800 A	1000 A	10000A	10000A
LG7653	100 A	400V~	left	300 mA	A	1000 A	1000 A	10000A	10000A
LG7654	25 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7655	40 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG7656	63 A	220/380V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG7657	80 A	220/380V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG7658	100 A	220/380V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A
LG7659	25 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7660	40 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
LG7661	63 A	220/380V~	left	30 mA	A	630 A	1000 A	10000A	10000A
LG7662	80 A	220/380V~	left	30 mA	A	800 A	1000 A	10000A	10000A
LG7663	100 A	220/380V~	left	30 mA	A	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

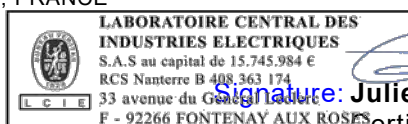

Signature: *Julien GAUTHIER*  
 Certification Officer

**ANNEX (continued)**

**TX<sup>3</sup> "Latin" serie**

References TX <sup>3</sup> « Latin » serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4030 08 LG7426	25 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4030 09 LG7427	40 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4030 10 LG7428	63 A	400V~	right	30 mA	AC	630 A	1000 A	10000A	10000A
LG1266 LG7429	80 A	400V~	right	30 mA	AC	800 A	1000 A	10000A	10000A
LG1267 LG7430	100 A	400V~	right	30 mA	AC	1000 A	1000 A	10000A	10000A
LG2621 LG7431	25 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
LG2622 LG7432	40 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
LG2623 LG7433	63 A	400V~	right	100 mA	AC	630 A	1000 A	10000A	10000A
LG2624 LG7434	80 A	400V~	right	100 mA	AC	800 A	1000 A	10000A	10000A
LG2625 LG7435	100 A	400V~	right	100 mA	AC	1000 A	1000 A	10000A	10000A
4030 42 LG7436	25 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4030 43 LG7437	40 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4030 44 LG7438	63 A	400V~	right	300 mA	AC	630 A	1000 A	10000A	10000A
LG2627 LG7439	80 A	400V~	right	300 mA	AC	800 A	1000 A	10000A	10000A
LG2628 LG7440	100 A	400V~	right	300 mA	AC	1000 A	1000 A	10000A	10000A
LG2630	25 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
LG2631	40 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
LG2632	63 A	400V~	right	500 mA	AC	630 A	1000 A	10000A	10000A
LG2633	80 A	400V~	right	500 mA	AC	800 A	1000 A	10000A	10000A
LG2634	100 A	400V~	right	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



Signature: *Julien Gauthier*  
**Julien GAUTHIER**  
Certification Officer


**ANNEX (continued)**

References TX <sup>3</sup> « Latin » serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1260 LG7441	25 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
LG1261 LG7442	40 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
LG1262 LG7443	63 A	400V~	right	30 mA	A	630 A	1000 A	10000A	10000A
LG1263 LG7444	80 A	400V~	right	30 mA	A	800 A	1000 A	10000A	10000A
LG1264 LG7445	100 A	400V~	right	30 mA	A	1000 A	1000 A	10000A	10000A
LG2637 LG7446	25 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
LG2638 LG7447	40 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
LG2639 LG7448	63 A	400V~	right	100 mA	A	630 A	1000 A	10000A	10000A
LG2640 LG7449	80 A	400V~	right	100 mA	A	800 A	1000 A	10000A	10000A
LG2641 LG7450	100 A	400V~	right	100 mA	A	1000 A	1000 A	10000A	10000A
LG2643 LG7451	25 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG2644 LG7452	40 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG2645 LG7453	63 A	400V~	right	300 mA	A	630 A	1000 A	10000A	10000A
LG2646 LG7454	80 A	400V~	right	300 mA	A	800 A	1000 A	10000A	10000A
LG2647 LG7455	100 A	400V~	right	300 mA	A	1000 A	1000 A	10000A	10000A
LG2649	25 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
LG2650	40 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
LG2651	63 A	400V~	right	500 mA	A	630 A	1000 A	10000A	10000A
LG2652	80 A	400V~	right	500 mA	A	800 A	1000 A	10000A	10000A
LG2653	100 A	400V~	right	500 mA	A	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

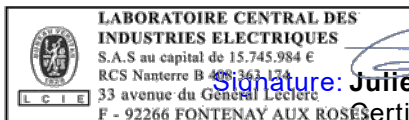

Signature: *Julien GAUTHIER*  
**Julien GAUTHIER**  
Certification Officer


## ANNEX (continued)

References TX <sup>3</sup> « Latin » serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4030 04	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4030 05	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4030 06	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG1268	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG1269	100 A	400V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A
LG2602	25 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG2603	40 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG2604	63 A	400V~	left	100 mA	AC	630 A	1000 A	10000A	10000A
LG2605	80 A	400V~	left	100 mA	AC	800 A	1000 A	10000A	10000A
LG2606	100 A	400V~	left	100 mA	AC	1000 A	1000 A	10000A	10000A
LG2608	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG2609	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG2610	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
LG2611	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG2612	100 A	400V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A
LG2614	25 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG2615	40 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG2616	63 A	400V~	left	500 mA	AC	630 A	1000 A	10000A	10000A
LG2617	80 A	400V~	left	500 mA	AC	800 A	1000 A	10000A	10000A
LG2618	100 A	400V~	left	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

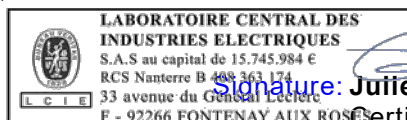

Signature: *Julien GAUTHIER*  
 Certification Officer



Ref. Certif. No.  
**FR\_705078/M1**

**ANNEX (continued)**

References XC <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4031 90	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4031 91	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4031 92	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
4031 93	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A

4031 94	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4031 95	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4031 96	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
4031 97	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A

References XC <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4032 32	25 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4032 33	40 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4032 34	63 A	400V~	left	30 mA	A	630 A	1000 A	10000A	10000A
4032 35	80 A	400V~	left	30 mA	A	800 A	1000 A	10000A	10000A

4032 36	25 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4032 37	40 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4032 38	63 A	400V~	left	300 mA	A	630 A	1000 A	10000A	10000A
4032 39	80 A	400V~	left	300 mA	A	800 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES  
S.A.S au capital de 15.745.984 €  
RCS Nanterre B 408 363 174  
33 avenue du Général Leclerc  
F - 92266 FONTENAY AUX ROSES  
Signature: *Julien Gauthier*  
Certification Officer



## ANNEX (continued)

References XC10 serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4 331 90	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4 331 91	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4 331 92	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
4 331 93	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG7776	100 A	400V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A

4 331 94	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4 331 95	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4 331 96	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
4 331 97	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG7777	100 A	400V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A

References XC10 serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4 332 32	25 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4 332 33	40 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4 332 34	63 A	400V~	left	30 mA	A	630 A	1000 A	10000A	10000A
4 332 35	80 A	400V~	left	30 mA	A	800 A	1000 A	10000A	10000A
LG7778	100 A	400V~	left	30 mA	A	1000 A	1000 A	10000A	10000A

4 332 36	25 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4 332 37	40 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4 332 38	63 A	400V~	left	300 mA	A	630 A	1000 A	10000A	10000A
4 332 39	80 A	400V~	left	300 mA	A	800 A	1000 A	10000A	10000A
LG7779	100 A	400V~	left	300 mA	A	1000 A	1000 A	10000A	10000A




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
 INDUSTRIES ELECTRIQUES  
 S.A.S au capital de 15.745.984 €  
 RCS Nanterre B 408 363 174  
 33 avenue du Général Leclerc  
 F - 92266 FONTENAY AUX ROSES

Signature:   
 Julien GAUTHIER  
 Certification Officer

## ANNEX (continued)


 RX<sup>3</sup> serie

References RX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 62	25 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4020 63	40 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4020 64	63 A	400V~	right	30 mA	AC	630 A	1000 A	10000A	10000A
LG1282	80 A	400V~	right	30 mA	AC	800 A	1000 A	10000A	10000A
LG1283	100 A	400V~	right	30 mA	AC	1000 A	1000 A	10000A	10000A
4020 66	25 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4020 67	40 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4020 68	63 A	400V~	right	100 mA	AC	630 A	1000 A	10000A	10000A
LG1284	80 A	400V~	right	100 mA	AC	800 A	1000 A	10000A	10000A
LG1285	100 A	400V~	right	100 mA	AC	1000 A	1000 A	10000A	10000A
4020 70	25 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4020 71	40 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4020 72	63 A	400V~	right	300 mA	AC	630 A	1000 A	10000A	10000A
LG1286	80 A	400V~	right	300 mA	AC	800 A	1000 A	10000A	10000A
LG1287	100 A	400V~	right	300 mA	AC	1000 A	1000 A	10000A	10000A
LG2804	25 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
LG2805	40 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
LG2806	63 A	400V~	right	500 mA	AC	630 A	1000 A	10000A	10000A
LG2807	80 A	400V~	right	500 mA	AC	800 A	1000 A	10000A	10000A
LG2808	100 A	400V~	right	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

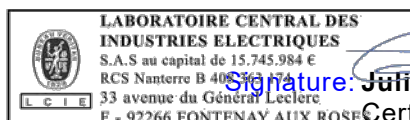

Signature: *Julien GAUTHIER*  
 Certification Officer



**ANNEX (continued)**

References RX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 74	25 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4020 75 4025 39	40 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4020 76 4025 40	63 A	400V~	right	30 mA	A	630 A	1000 A	10000A	10000A
LG1270	80 A	400V~	right	30 mA	A	800 A	1000 A	10000A	10000A
LG1271	100 A	400V~	right	30 mA	A	1000 A	1000 A	10000A	10000A

LG1272	25 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
LG1273	40 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
LG1274	63 A	400V~	right	100 mA	A	630 A	1000 A	10000A	10000A
LG1275	80 A	400V~	right	100 mA	A	800 A	1000 A	10000A	10000A
LG1276	100 A	400V~	right	100 mA	A	1000 A	1000 A	10000A	10000A

LG1277	25 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG1278 4025 41	40 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
LG1279 4025 42	63 A	400V~	right	300 mA	A	630 A	1000 A	10000A	10000A
LG1280	80 A	400V~	right	300 mA	A	800 A	1000 A	10000A	10000A
LG1281	100 A	400V~	right	300 mA	A	1000 A	1000 A	10000A	10000A

LG2814	25 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
LG2815	40 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
LG2816	63 A	400V~	right	500 mA	A	630 A	1000 A	10000A	10000A
LG2817	80 A	400V~	right	500 mA	A	800 A	1000 A	10000A	10000A
LG2818	100 A	400V~	right	500 mA	A	1000 A	1000 A	10000A	10000A

References RX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 90	25 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4020 91	40 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4020 92	63 A	220/380V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG1288	80 A	220/380V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG1289	100 A	220/380V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A

These products are dedicated to Brazilian and Mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
INDUSTRIES ELECTRIQUES  
S.A.S au capital de 15.745.984 €  
RCS Nanterre B 408.363.174  
33 avenue du Général Leclerc  
F - 92266 FONTENAY AUX ROSES

Signature: *Julien GAUTHIER*  
Certification Officer



Ref. Certif. No.  
**FR\_705078/M1**

**ANNEX (continued)**

**DX<sup>3</sup> serie**

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 02	25 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4117 03	40 A	400V~	right	30 mA	AC	500 A	1000 A	10000A	10000A
4117 04	63 A	400V~	right	30 mA	AC	630 A	1000 A	10000A	10000A
4117 05	80 A	400V~	right	30 mA	AC	800 A	1000 A	10000A	10000A
LG992	100 A	400V~	right	30 mA	AC	1000 A	1000 A	10000A	10000A
4117 12	25 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4117 13	40 A	400V~	right	100 mA	AC	500 A	1000 A	10000A	10000A
4117 14	63 A	400V~	right	100 mA	AC	630 A	1000 A	10000A	10000A
4117 15	80 A	400V~	right	100 mA	AC	800 A	1000 A	10000A	10000A
LG993	100 A	400V~	right	100 mA	AC	1000 A	1000 A	10000A	10000A
4117 22	25 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4117 23	40 A	400V~	right	300 mA	AC	500 A	1000 A	10000A	10000A
4117 24	63 A	400V~	right	300 mA	AC	630 A	1000 A	10000A	10000A
4117 25	80 A	400V~	right	300 mA	AC	800 A	1000 A	10000A	10000A
LG994	100 A	400V~	right	300 mA	AC	1000 A	1000 A	10000A	10000A
4117 32	25 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
4117 33	40 A	400V~	right	500 mA	AC	500 A	1000 A	10000A	10000A
4117 34	63 A	400V~	right	500 mA	AC	630 A	1000 A	10000A	10000A
4117 35	80 A	400V~	right	500 mA	AC	800 A	1000 A	10000A	10000A
LG995	100 A	400V~	right	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



Signature: *Julien Gauthier*  
**Julien GAUTHIER**  
Certification Officer


**ANNEX (continued)**

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 59	25 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4117 60	40 A	400V~	right	30 mA	A	500 A	1000 A	10000A	10000A
4117 61	63 A	400V~	right	30 mA	A	630 A	1000 A	10000A	10000A
4117 62	80 A	400V~	right	30 mA	A	800 A	1000 A	10000A	10000A
4117 63	100 A	400V~	right	30 mA	A	1000 A	1000 A	10000A	10000A
4117 69	25 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
4117 70	40 A	400V~	right	100 mA	A	500 A	1000 A	10000A	10000A
4117 71	63 A	400V~	right	100 mA	A	630 A	1000 A	10000A	10000A
4117 72	80 A	400V~	right	100 mA	A	800 A	1000 A	10000A	10000A
4117 73	100 A	400V~	right	100 mA	A	1000 A	1000 A	10000A	10000A
4117 79	25 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
4117 80	40 A	400V~	right	300 mA	A	500 A	1000 A	10000A	10000A
4117 81	63 A	400V~	right	300 mA	A	630 A	1000 A	10000A	10000A
4117 82	80 A	400V~	right	300 mA	A	800 A	1000 A	10000A	10000A
4117 83	100 A	400V~	right	300 mA	A	1000 A	1000 A	10000A	10000A
4117 89	25 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
4117 90	40 A	400V~	right	500 mA	A	500 A	1000 A	10000A	10000A
4117 91	63 A	400V~	right	500 mA	A	630 A	1000 A	10000A	10000A
4117 92	80 A	400V~	right	500 mA	A	800 A	1000 A	10000A	10000A
4117 93	100 A	400V~	right	500 mA	A	1000 A	1000 A	10000A	10000A




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

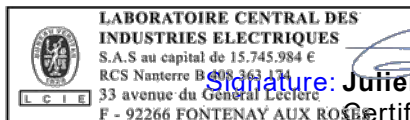

Signature: *Julien GAUTHIER*  
Certification Officer

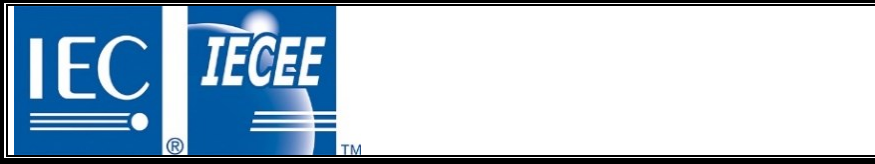

Ref. Certif. No.  
**FR\_705078/M1**


**ANNEX (continued)**

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1118	25 A	400V~	right	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG996	40 A	400V~	right	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG997	63 A	400V~	right	100 mA	AC-S	630 A	1000 A	10000A	10000A
LG1119	80 A	400V~	right	100 mA	AC-S	800 A	1000 A	10000A	10000A
LG1120	100 A	400V~	right	100 mA	AC-S	1000 A	1000 A	10000A	10000A
LG1121	25 A	400V~	right	300 mA	AC-S	500 A	1000 A	10000A	10000A
4117 45	40 A	400V~	right	300 mA	AC-S	500 A	1000 A	10000A	10000A
4117 46	63 A	400V~	right	300 mA	AC-S	630 A	1000 A	10000A	10000A
LG1122	80 A	400V~	right	300 mA	AC-S	800 A	1000 A	10000A	10000A
LG1123	100 A	400V~	right	300 mA	AC-S	1000 A	1000 A	10000A	10000A
LG1124	25 A	400V~	right	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG1125	40 A	400V~	right	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG1126	63 A	400V~	right	500 mA	AC-S	630 A	1000 A	10000A	10000A
LG1127	80 A	400V~	right	500 mA	AC-S	800 A	1000 A	10000A	10000A
LG1128	100 A	400V~	right	500 mA	AC-S	1000 A	1000 A	10000A	10000A
References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1031	25 A	400V~	right	100 mA	A-S	500 A	1000 A	10000A	10000A
LG1032	40 A	400V~	right	100 mA	A-S	500 A	1000 A	10000A	10000A
LG1033	63 A	400V~	right	100 mA	A-S	630 A	1000 A	10000A	10000A
LG1034	80 A	400V~	right	100 mA	A-S	800 A	1000 A	10000A	10000A
LG1035	100 A	400V~	right	100 mA	A-S	1000 A	1000 A	10000A	10000A
LG998	25 A	400V~	right	300 mA	A-S	500 A	1000 A	10000A	10000A
4118 00	40 A	400V~	right	300 mA	A-S	500 A	1000 A	10000A	10000A
4118 01	63 A	400V~	right	300 mA	A-S	630 A	1000 A	10000A	10000A
LG999	80 A	400V~	right	300 mA	A-S	800 A	1000 A	10000A	10000A
LG1000	100 A	400V~	right	300 mA	A-S	1000 A	1000 A	10000A	10000A
LG1001	25 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
LG1002	40 A	400V~	right	500 mA	A-S	500 A	1000 A	10000A	10000A
LG1003	63 A	400V~	right	500 mA	A-S	630 A	1000 A	10000A	10000A
LG1004	80 A	400V~	right	500 mA	A-S	800 A	1000 A	10000A	10000A
LG1005	100 A	400V~	right	500 mA	A-S	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

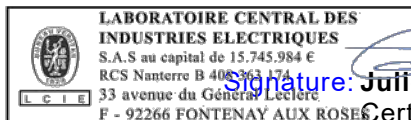

Signature: *Julien GAUTHIER*  
Certification Officer

## ANNEX (continued)

References DX <sup>2</sup> serie	In	Un	Neutral position	IΔn	Type	I <sub>m</sub>	IΔm	I <sub>nc</sub>	IΔc
LG3181	25 A	400V~	right	30 mA	AC*	500 A	1000 A	10000A	10000A
LG3182	40 A	400V~	right	30 mA	AC*	500 A	1000 A	10000A	10000A
LG3183	63 A	400V~	right	30 mA	AC*	630 A	1000 A	10000A	10000A
LG3184	80 A	400V~	right	30 mA	AC*	800 A	1000 A	10000A	10000A
LG3185	100 A	400V~	right	30 mA	AC*	1000 A	1000 A	10000A	10000A
LG3187	25 A	400V~	right	100 mA	AC*	500 A	1000 A	10000A	10000A
LG3188	40 A	400V~	right	100 mA	AC*	500 A	1000 A	10000A	10000A
LG3189	63 A	400V~	right	100 mA	AC*	630 A	1000 A	10000A	10000A
LG3190	80 A	400V~	right	100 mA	AC*	800 A	1000 A	10000A	10000A
LG3191	100 A	400V~	right	100 mA	AC*	1000 A	1000 A	10000A	10000A
LG3193	25 A	400V~	right	300 mA	AC*	500 A	1000 A	10000A	10000A
LG3194	40 A	400V~	right	300 mA	AC*	500 A	1000 A	10000A	10000A
LG3195	63 A	400V~	right	300 mA	AC*	630 A	1000 A	10000A	10000A
LG3196	80 A	400V~	right	300 mA	AC*	800 A	1000 A	10000A	10000A
LG3197	100 A	400V~	right	300 mA	AC*	1000 A	1000 A	10000A	10000A

\* RCCB's dedicated to Austria market



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
 INDUSTRIES ELECTRIQUES  
 S.A.S au capital de 15.745.984 €  
 RCS Nanterre B 408 863 174  
 33 avenue du Général Leclerc  
 F - 92266 FONTENAY AUX ROSES

Signature:  **Julien GAUTHIER**  
 Certification Officer


## ANNEX (continued)

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4116 60	25 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4116 61	40 A	400V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
4116 62	63 A	400V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
4116 63	80 A	400V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG1021	100 A	400V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A
LG3102	25 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG3103	40 A	400V~	left	100 mA	AC	500 A	1000 A	10000A	10000A
LG3104	63 A	400V~	left	100 mA	AC	630 A	1000 A	10000A	10000A
LG3105	80 A	400V~	left	100 mA	AC	800 A	1000 A	10000A	10000A
LG3106	100 A	400V~	left	100 mA	AC	1000 A	1000 A	10000A	10000A
4116 64	25 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4116 65	40 A	400V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
4116 66	63 A	400V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
4116 67	80 A	400V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG1022	100 A	400V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A
LG3109	25 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG3110	40 A	400V~	left	500 mA	AC	500 A	1000 A	10000A	10000A
LG3111	63 A	400V~	left	500 mA	AC	630 A	1000 A	10000A	10000A
LG3112	80 A	400V~	left	500 mA	AC	800 A	1000 A	10000A	10000A
LG3113	100 A	400V~	left	500 mA	AC	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



Signature: *Julien Gauthier*  
**Julien GAUTHIER**  
 Certification Officer




## ANNEX (continued)

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4116 74	25 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4116 75	40 A	400V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4116 76	63 A	400V~	left	30 mA	A	630 A	1000 A	10000A	10000A
4116 77	80 A	400V~	left	30 mA	A	800 A	1000 A	10000A	10000A
4116 78	100 A	400V~	left	30 mA	A	1000 A	1000 A	10000A	10000A
LG3129	25 A	400V~	left	100 mA	A	500 A	1000 A	10000A	10000A
LG3130	40 A	400V~	left	100 mA	A	500 A	1000 A	10000A	10000A
LG3131	63 A	400V~	left	100 mA	A	630 A	1000 A	10000A	10000A
LG3132	80 A	400V~	left	100 mA	A	800 A	1000 A	10000A	10000A
LG3133	100 A	400V~	left	100 mA	A	1000 A	1000 A	10000A	10000A
4116 84	25 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4116 85	40 A	400V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4116 86	63 A	400V~	left	300 mA	A	630 A	1000 A	10000A	10000A
4116 87	80 A	400V~	left	300 mA	A	800 A	1000 A	10000A	10000A
4116 88	100 A	400V~	left	300 mA	A	1000 A	1000 A	10000A	10000A
LG3136	25 A	400V~	left	500 mA	A	500 A	1000 A	10000A	10000A
LG3137	40 A	400V~	left	500 mA	A	500 A	1000 A	10000A	10000A
LG3138	63 A	400V~	left	500 mA	A	630 A	1000 A	10000A	10000A
LG3139	80 A	400V~	left	500 mA	A	800 A	1000 A	10000A	10000A
LG3140	100 A	400V~	left	500 mA	A	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

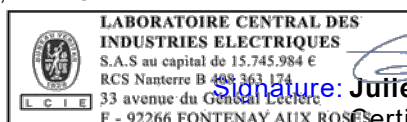


## ANNEX (continued)

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG3115	25 A	400V~	left	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG3116	40 A	400V~	left	100 mA	AC-S	500 A	1000 A	10000A	10000A
LG3117	63 A	400V~	left	100 mA	AC-S	630 A	1000 A	10000A	10000A
LG3118	80 A	400V~	left	100 mA	AC-S	800 A	1000 A	10000A	10000A
LG3119	100 A	400V~	left	100 mA	AC-S	1000 A	1000 A	10000A	10000A
LG1129	25 A	400V~	left	300 mA	AC-S	500 A	1000 A	10000A	10000A
4116 68	40 A	400V~	left	300 mA	AC-S	500 A	1000 A	10000A	10000A
4116 69	63 A	400V~	left	300 mA	AC-S	630 A	1000 A	10000A	10000A
LG1130	80 A	400V~	left	300 mA	AC-S	800 A	1000 A	10000A	10000A
LG1131	100 A	400V~	left	300 mA	AC-S	1000 A	1000 A	10000A	10000A
LG3122	25 A	400V~	left	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG3123	40 A	400V~	left	500 mA	AC-S	500 A	1000 A	10000A	10000A
LG3124	63 A	400V~	left	500 mA	AC-S	630 A	1000 A	10000A	10000A
LG3125	80 A	400V~	left	500 mA	AC-S	800 A	1000 A	10000A	10000A
LG3126	100 A	400V~	left	500 mA	AC-S	1000 A	1000 A	10000A	10000A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023

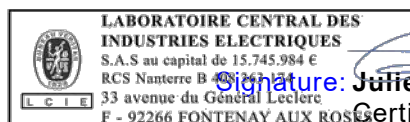

Signature: *Julien GAUTHIER*  
 Julien GAUTHIER  
 Certification Officer



**ANNEX (continued)**

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG3252	25 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG3253	40 A	220/380V~	left	30 mA	AC	500 A	1000 A	10000A	10000A
LG3254	63 A	220/380V~	left	30 mA	AC	630 A	1000 A	10000A	10000A
LG3255	80 A	220/380V~	left	30 mA	AC	800 A	1000 A	10000A	10000A
LG3256	100 A	220/380V~	left	30 mA	AC	1000 A	1000 A	10000A	10000A

LG3258	25 A	220/380V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG3259	40 A	220/380V~	left	300 mA	AC	500 A	1000 A	10000A	10000A
LG3260	63 A	220/380V~	left	300 mA	AC	630 A	1000 A	10000A	10000A
LG3261	80 A	220/380V~	left	300 mA	AC	800 A	1000 A	10000A	10000A
LG3262	100 A	220/380V~	left	300 mA	AC	1000 A	1000 A	10000A	10000A

References DX <sup>3</sup> serie	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4118 32	25 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4118 33	40 A	220/380V~	left	30 mA	A	500 A	1000 A	10000A	10000A
4118 34	63 A	220/380V~	left	30 mA	A	630 A	1000 A	10000A	10000A
4118 35	80 A	220/380V~	left	30 mA	A	800 A	1000 A	10000A	10000A
4118 36	100 A	220/380V~	left	30 mA	A	1000 A	1000 A	10000A	10000A

4118 37	25 A	220/380V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4118 38	40 A	220/380V~	left	300 mA	A	500 A	1000 A	10000A	10000A
4118 39	63 A	220/380V~	left	300 mA	A	630 A	1000 A	10000A	10000A
4118 40	80 A	220/380V~	left	300 mA	A	800 A	1000 A	10000A	10000A
4118 41	100 A	220/380V~	left	300 mA	A	1000 A	1000 A	10000A	10000A

These products are dedicated to Brazilian and Mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
33 avenue du Général Leclerc  
92260 Fontenay-aux-Roses, FRANCE  
[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES  
S.A.S au capital de 15.745.984 €  
RCS Nanterre B 388 363 171  
33 avenue du Général Leclerc  
F - 92266 FONTENAY AUX ROSES

Signature: *Julien Gauthier*  
**Julien GAUTHIER**  
Certification Officer

**ANNEX (End)**

Independent of line voltage :	yes
Rated voltage (V)	400 V and 220/380V (for dual voltage products)
Rated current (A)	25A – 40A – 63A – 80A – 100A
Rated frequency : (Hz)	50 Hz
Delay time	without or with S
Nature of supply :	~
Total number of poles :	4
Rated residual operating current (A)	0.030A, 0.100A, 0.300A, 0.500A
Rated insulation voltage $U_i$ : (V)	500 V~
Rated impulse withstand voltage $U_{imp}$ : (V)	4 000 V
Utilisation range temperature : (°C)	-25 °C à/to +40 °C
Rated residual making and breaking capacity $I_{\Delta m}$ : (A)	1 000 A
Rated conditional short-circuit current $I_{nc}$ : (A)	10 000 A
Rated conditional residual short-circuit current $I_{\Delta c}$ : (A)	10 000 A
Short-circuit tests :	35mm
Protection against external influences :	enclosed
Protection degree :	IP20
Material group :	II
Method of mounting :	panel board – on rail
Not associated with the mechanical-mounting	
Type of terminals :	pillar terminals



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE  
 33 avenue du Général Leclerc  
 92260 Fontenay-aux-Roses, FRANCE

[www.lcie.fr](http://www.lcie.fr)

Date: 20/07/2023



LABORATOIRE CENTRAL DES  
 INDUSTRIES ELECTRIQUES  
 S.A.S au capital de 15.745.984 €  
 RCS Nanterre B 408 363 174  
 33 avenue du Général Leclerc  
 F - 92266 FONTENAY AUX ROSES

Signature:  **Julien GAUTHIER**  
 Certification Officer