

DX³ RCCBs - ID B type

Cat. N°(s) : 4119 56, 4119 57, 4119 61, 4119 62, 4119 66,
4119 67, 4119 71, 4119 72




CONTENTS	PAGES
1. Description, use	1
2. Range	1
3. Overall dimensions	1
4. Preparation - Connection	1
5. General characteristics	3
6. Compliance	5
7. Auxiliaries and accessories	6
8. Safety	6

1. DESCRIPTION - USE

RCCBs with positive contact indication for control, protection and isolation of electrical circuits, protecting people from direct and indirect contact and protecting installations from insulation faults.

Symbole :



Technology :

. Electromagnetic and electronic residual current function with current-sensing relay

2. RANGE

Polarity:

- . 2-pole
- . 4-pole

Width :

- . 4 modules (4 x 17,8 mm)

Nominal rating In :

- . 40 / 63 A

Residual current types:

- . AC (residual sinusoidal alternating currents)
- . A (residual alternating currents with a DC component)
- . F (residual currents at high frequency component)
- . B (residual sinusoidal alternating currents up to 1 kHz, smoothed pulsed and continuous residual currents)

Sensitivity:

- . 30 / 300 mA

Nominal voltage and frequency:

- . 2-pole: 230 V~, 50 Hz with standard tolerances
- . 4-pole: 400 V~, 50 Hz with standard tolerances

2. GAMME (suite)


Maximum operating voltage:

- . 2-pole: 253 V~
- . 4-pole: 440 V~

Minimum operating voltage:

- . To detect differential currents of type A/AC : 0 V
- . To detect differential currents of type F/B : 50 V~

3. OVERALL DIMENSIONS

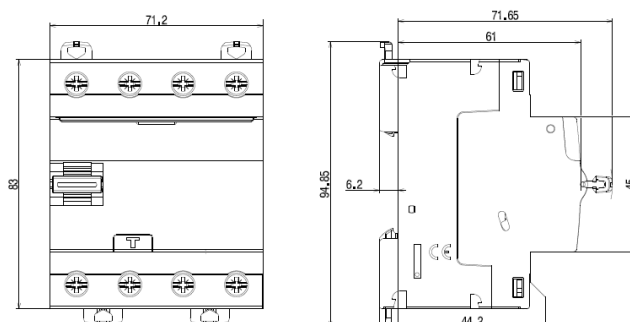


4. PREPARATION - CONNECTION

Mounting:

- . On symmetrical rail EN 60715 or DIN 35 rail

Operating positions:

- . Vertical, horizontal, flat, upside down



Power supply:

- . From the top or the bottom

Connection:

- . Inputs and outputs via screw terminals
- . Neutral on left

4. PREPARATION - CONNECTION (continued)

Terminal arrangement :

- . Cage terminals, with disengageable and captive screws
- . Cage terminals fitted with flaps preventing a cable being placed under the terminal, with the terminal partly open or closed
- . Terminals protected against direct finger contact IP20, wired
- . Alignment and spacing of the terminals permitting connection with the other products in the range via toothed supply busbars
- . A RCCB may be replaced in the middle of a row supplied with busbars without disconnecting the other products


Put the lugs in the unlocking position

Put the latch clips in the unlocking position

Unscrew the upper terminals completely

Pull the device forward in order to release it from the rail

Pull the device downward in order to release it completely from the prongs of the busbar

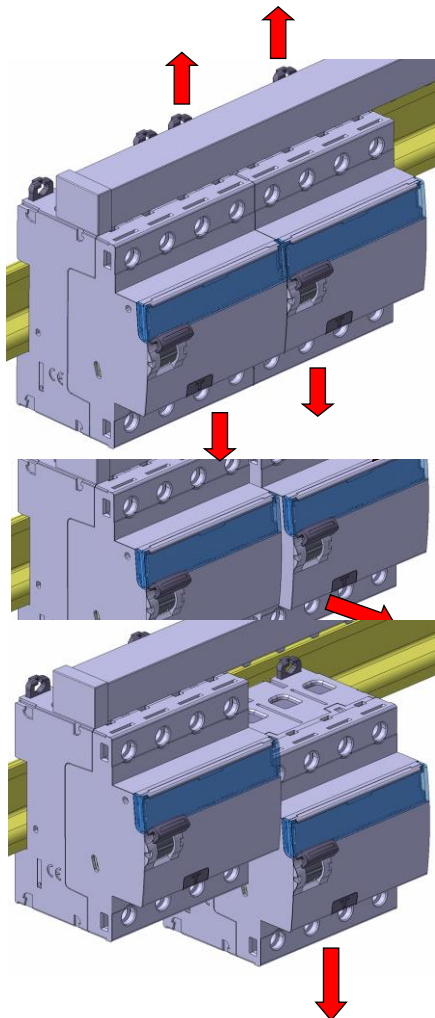

4. PREPARATION - CONNECTION (continued)

Terminal arrangement : (continued)

- . Terminal depth: 14 mm
- . Screw head: mixed head, slotted head and Philips / Pozidriv no. 2
- Tightening torques:
 - Minimum / Maximum: 1.2 Nm / 3.5 Nm
 - Recommended: 2.5 Nm

Conductor types:

- . Copper cables at the top and bottom of the product
- Cable cross-section:

	Without ferrule	With ferrule
Rigid cable	1 x 0.75 to 50 mm ² or 2 x 0.75 to 16 mm ²	/
Flexible cable	1 x 0.75 to 35 mm ² or 2 x 0.75 to 16 mm ²	1 x 0.75 to 25 mm ²

Required tools:

- . For the terminals:
 - 5.5 mm / 6.5 mm blade screwdriver recommended
 - Pozidriv n°2 / Philips N°2 screwdriver recommended
- . For the latching:
 - 5.5 mm blade screwdriver recommended / 6 mm maximum
 - Pozidriv n°2 / Philips N°2 screwdriver recommended

Device handling:

- . Manual action via ergonomic 2 position handle:
 - I-On, device closed O-Off, device open

Contact status display:

- . By marking of the handle:
 - I-On, in white on a red background: closed contacts
 - O-Off, in white on a green background: contacts open

Residual current trip display:

- . Handle at the bottom position, the residual current is released

Sealing:

- . Possible in the open or closed positions

Labelling:

- . Circuit identification by way of a label inserted in the label holder situated on the front of the product



5. GENERAL CHARACTERISTICS

Neutral earthing system:

. IT, TT and TN

Marking:

. "N" marking of the neutral
. Marking on the "front side" by permanent ink pad printing
. Marking on the "upper panel" by permanent ink pad printing

Test operating voltage:

. 2-pole: from 120 V to 253 V~
. 4-pole: from 220 V to 440 V ~ between pole 1/2 and pole 3/4

Rated conditional short-circuit current:

. Inc = 10 kA, in accordance with EN/IEC 61008-1

Rated conditional short-circuit residual current:

. IΔc = 10 kA, in accordance with EN/IEC 61008-1

Rated residual breaking capacity:

. IΔm = 1000 A, in accordance with EN/IEC 61008-1

Rated breaking and making capacity:

In accordance with EN/IEC 61008-1,
. In = 40 A : Im = 500 A
. In = 63 A : Im = 630 A

Power dissipated by the device:

RCCB			Power dissipated by the device (In)
Pole	Rating	Sensitivity	Type B
2P	40 A	30 mA	3.2 W
		300 mA	3.2 W
	63 A	30 mA	8.2 W
		300 mA	8.2 W
4P	40 A	30 mA	4.7 W
		300 mA	4.7 W
	63 A	30 mA	12.1 W
		300 mA	12.1 W

Temperature derating:

. Reference temperature: 30°C in accordance with standard IEC/EN 60947-2

In (A)	Ambient Temperature/In								
	- 25°C	- 10°C	0°C	10°C	20°C	30°C	40°C	50°C	60°C
40 A	40	40	40	40	40	40	40	25	25
63 A	63	63	63	63	63	63	63	40	40

Specific use:

. Appropriate to operate in humid atmosphere and polluted by a chlorine environment (pool type)

DX³ RCCBs - ID B type

Cat. N° : 4119 56, 4119 57, 4119 61, 4119 62, 4119 66,
4119 67, 4119 71, 4119 72

5. GENERAL CHARACTERISTICS (continued)

Weight per device:

Catalogue Number	Description	Weight (kg)
4119 56	2P 40A B type 30mA	0,28
4119 57	2P 63A B type 30mA	0,28
4119 61	2P 40A B type 300mA	0,28
4119 62	2P 63A B type 300mA	0,28
4119 66	4P 40A B type 30mA	0,35
4119 67	4P 63A B type 30mA	0,35
4119 71	4P 40A B type 300mA	0,35
4119 72	4P 63A B type 300mA	0,35

Packaged volume and quantity:

	Volume (dm ³)	Packaging
For all catalogue numbers	0.70	per unit

Isolation distance: (distance between the contacts)

- . Handle in open position - O-Off:
 - Neutral pole: greater than 4.5 mm
 - Phase pole: greater than 5.5 mm

Rated insulation voltage:

- . $U_i = 500$ V

Insulation resistance:

- . 2 M Ω

Degree of pollution:

- . 2

Dielectric strength:

- . 2000 V - 50 Hz

Impulse withstand voltage:

- . $U_{imp} = 4$ kV

Protection from false tripping:

- . 0,5 μ s/100 kHz damped recurring wave = 200 A
- . 8/20 μ s wave:
 - B type = 3000 A

Protection classes:

- . Terminals protected against direct contact:
 - IP20 (wired device)
- . Front side protected against direct contact:
 - IP40
- . Class II in relation to metallic conductive parts
- . Protection against impacts:
 - IK04

5. GENERAL CHARACTERISTICS (continued)

Plastic materials used:

- . Parts made of polyamide and P.B.T.

Enclosure heat and fire resistance:

- . Resistance to incandescent wire tests at 960°C, in accordance with standard IEC/EN 61008-1
- . Classification V2, in accordance with standard UL94

Device's upper heating value:

- . Estimated heating value of a 4P 40A 30mA B type device: 4.30 MJ

Handle opening and closing forces:

- . Force of 42 N for closing - (all ratings)
- . Force of 13 N for opening - (all ratings)

Mechanical endurance:

- . Conforms to standard NF EN 61008-1
- . Tested with 20,000 operations with no load

Electrical endurance:

- . Conforms to standard NF EN 61008-1
- . Tested with 10,000 operations with load (at $I_n \times \cos \varphi 0.9$)
- . Tested with 2,000 residual current trip operations using the test button or the fault current

Operating ambient temperature:

- . -25°C / +60°C

Storage temperature:

- . -40°C / +70°C

DC operation:

- . Cannot be used with DC

Operation at 400 Hz:

- . Cannot be used at 400 Hz

Operation at 60 Hz :

- . Cannot be used at 60 Hz

Resistance to sinusoidal vibrations: (in accordance with IEC 68.2.6)

- . Axes: x / y / z
- . Frequency: 10 to 55 Hz
- . Acceleration: 3 g (1 g = 9.81 m.s⁻²)

Resistance to tremors :

- . Conforms to standard NF EN 61008-1

5. GENERAL CHARACTERISTICS *(continued)*

Derating of RCCBs function of the number of devices placed side by side:

When several RCCBs are installed side by side and operate simultaneously, the heat dissipation of one pole is limited. This results in an increased operating temperature for the RCCBs which may cause false tripping. Applying the following coefficients to the operating currents is recommended.

Number of circuit breakers side by side	Coefficient
2 - 3	0.9
4 - 5	0.8
6 - 9	0.7
≥ 10	0.6

These values are provided by recommendation IEC 60439-1 and the standards NF C 63421 and EN 60439-1. In order to avoid having to use these coefficients there must be good ventilation and the devices must be kept apart using the spacing elements Cat. No. 4 063 07 (0.5 module).

Impact of height:

	2,000 m	3,000 m	4,000 m	5,000 m
Dielectric strength	2,000 V	2,000 V	2,000 V	1,500 V
Maximum operating voltage	400 V	400 V	400 V	400 V
Derating at 30°C	none	none	none	none

6. COMPLIANCE AND APPROVALS

Reference product standards:

- . NF EN 61008-1/IEC 61008-1
- . NF EN 62423 / IEC 62423
- . EN/IEC 60 529 (IP)

Environment:

- . Compliance with European Union Directives
- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/94

Usage in special conditions:

- . Category C compliant (testing temperature of -25°C to +70°C, resistant to salt spray) in accordance with the classification defined in Appendix Q of standard IEC/EN 60947-1

Plastic materials:

- . Zero halogen plastic materials.
- . Labelling compliant with ISO 11469 and ISO 1043.

Packaging:

- . Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

7. EQUIPEMENT ET ACCESSOIRES

Wiring accessories:

- . Sealable screw cover (Cat. No. 4 063 04)
- . Supply busbar: HX³ 3/4-pole supply busbar
- . Terminal for aluminium cable with max. 50 mm² cross-section (Cat. No. 4 063 10)

Signalling auxiliaries:

- . Auxiliary contact (0.5 module, Cat. No. 4 062 58)
- . Fault signalling contact (0.5 module, Cat. No. 4 062 60)
- . Auxiliary contact that can be changed into fault signalling contact (0.5 module, Cat. No. 4 062 62)
- . Auxiliary contact + fault signalling contact that can be changed into 2 auxiliary contacts (1 module, Cat. No. 4 062 66)

Control auxiliaries:

- . Shunt trip (1 module, Cat. No. 4 062 76, 2 78)
- . Undervoltage release (1 module, Cat. No. 4 062 80, 2 82)
- . Stand-alone release for N/C push-button (1.5 module, Cat. No. 4 062 87)

Motorised controls:

- . Motor-driven control (1 module, Cat. No. 4 062 91)
- . Motor-driven control with integrated automatic reset (2 modules, Cat. Nos. 4 062 93, 2 95)

Possible combinations of auxiliaries and RCCBs:

- . The auxiliaries are installed to the left of the RCCBs
- . Maximum number of auxiliaries = 3
- . Maximum number of 1 module signalling auxiliaries = 2
- . Maximum number of control auxiliaries (Cat. Nos. 4 062 76 to 4 062 87) = 1
- . The control auxiliary (trip Cat. Nos. 4 062 76 to 4 062 87) must mandatorily be placed to the left of the signalling auxiliaries (Cat. Nos. 4 062 58 to 4 062 66) where the auxiliaries from these 2 families are connected to the same RCCB

Sealing:

- . Possible in the open or closed positions

Lockout possibilities:

- . Via Ø 5 mm padlock (Cat. No. 4 063 13) or Ø 6 mm padlock (Cat. Nos. 227 97) and padlock support (Cat. No. 4 063 03)

Installation software:

- . XL PRO³

8. SAFETY

. For your safety your electrical installation is equipped with residual current protection and this must be tested periodically. In the absence of any national regulations on the time period required for this, Legrand recommends that this test be carried out every month: press the "T" test button, the device should trip. Please call an electrician immediately if this does not happen as your installation's safety level has been reduced

. The presence of residual current protection does not remove the need to observe all the precautions associated with using electrical energy