


## 3-zone LIGHT UP DALI corridor sensor

Cat. No(s): 0 485 56



[Access to the full LIGHT UP documentation](#)

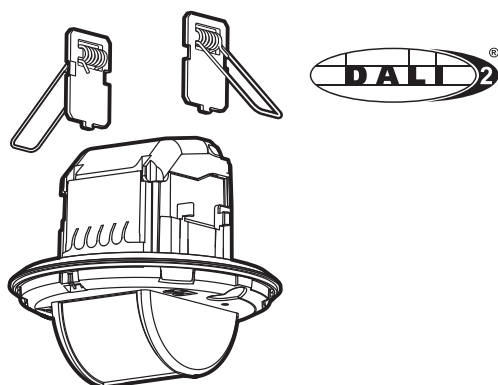

CONTENTS	PAGE
1. Use .....	1
2. Technical characteristics .....	1
3. Loads .....	2
4. Dimensions .....	2
5. Description .....	2
6. Mounting .....	2
7. Wiring .....	3
8. Installation .....	4
9. Performance .....	5
10. Modes .....	5
11. Legrand CLOSE UP app .....	5
12. Settings with CLOSE UP .....	6
13. Surface-mounting accessory .....	7
14. Description of buttons and LEDs .....	8
15. Standards .....	9
16. Care .....	9
17. Troubleshooting .....	9

### 1. USE

This product is a DALI presence sensor.

The presence sensor has a 360° detection angle.

It has:

- The option of being paired with a **wireless batteryless switch** and/or controlling a **connected power outlet**.
- **1 auxiliary input** for overriding lighting using the wired push-button.
- **1 presence sensor** (PIR technology) with lens for detecting occupancy.
- **1 daylight sensor** which measures natural and artificial light in order to control lighting according to the desired lighting setpoint.
- **1 DALI output** for supplying the bus and controlling lighting.

#### ■ 1.1 Bluetooth 5.0

For commissioning the product in a connectable system using the **LEGRAND CLOSE UP** mobile app.  
Product updating.

#### ■ 1.2 Radio (2.4 - 2.483 GHz)

Creation of a standalone system, for managing 1 power outlet and 1 radio-controlled switch.

#### ■ 1.3 Management of 3 lighting zones



3-zone LIGHT UP DALI sensors can control 3 lighting zones:

- "window" group dimming
- "corridor" group dimming
- "panel" group ON/OFF

A wireless batteryless switch only controls the ON/OFF output in the "Panel" section.

A wired push-button controls the two other zones: ON/OFF and dimming.

### 2. TECHNICAL CHARACTERISTICS

#### ■ 2.1 Consumption

- Voltage: 110 - 230 V~
- Frequency: 50/60 Hz

#### ■ 2.2 Standby consumption

- OFF load → 0.85 W
- ON load → 0.85 W

#### ■ 2.3 Installation

- Installation in false ceiling
- Screw terminals: 2 x 1.5 mm<sup>2</sup> or 1 x 2.5 mm<sup>2</sup>
- Drilling diameter: 68 mm

#### ■ 2.4 Mechanical characteristics

- Impact resistance: IK04
- Penetration by solid and liquid matter: IP20
- Weight:
  - of product: 239.1 g
  - packaged: 283.2 g

#### ■ 2.5 Climate characteristics

- Usage temperature: -10°C to +30°C
- Storage temperature: -20°C to +70°C

#### ■ 2.6 Sensor

- Infrared
- Detection diameter: 24 m x 3 m (for a height of 2.5 m from the floor)
- Minimum installation height: 1.7 m

#### ■ 2.7 Factory settings

- Light level: 150 lux
- Time delay: 10 minutes
- Walkthrough mode

#### ■ 2.8 Bluetooth

- Version 5.0 compatible from 4.2 upwards
- Frequency: 2.4 to 2.483 GHz
- Output power: +8 dBm
- Range: 10 m

#### ■ 2.9 Radio

- Frequency: 2.4 GHz (16 channels)
- Output power: +8 dBm
- Data rate: 250 kbps
- Range: 10 m
- Security: Wireless mesh network, self-adaptive and secure (AES 128), conforming to standard IEEE 802.15.4 (LR-WPAN)

## 2. TECHNICAL CHARACTERISTICS (CONTINUED)


### ■ 2.10 Declaration of conformity

- **f (Frequency):** 2.4 to 2.483 GHz
- **P (Power):** <100 mW


LEGRAND declares that the radio-electric equipment type Cat. No. **0 485 56** complies with directive 2014/53/EU. The full text of the EU declaration of conformity is available on the following website: [www.legrand.com/ecatalogue](http://www.legrand.com/ecatalogue)

## 3. LOADS


### ■ 3.1 DALI

- Voltage: 15 V 
- Guaranteed current: 100 mA
- Maximum current: 130 mA





## 4. DIMENSIONS

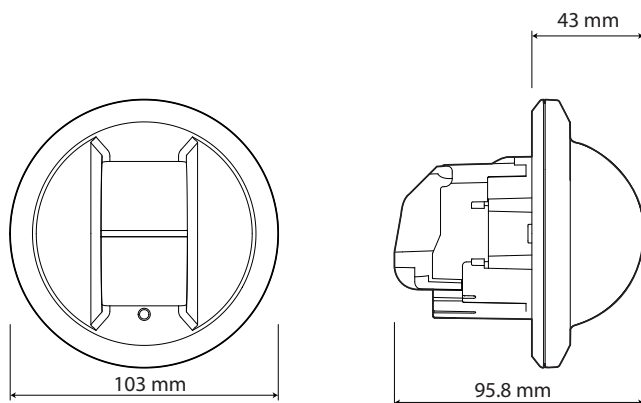

## 5. DESCRIPTION

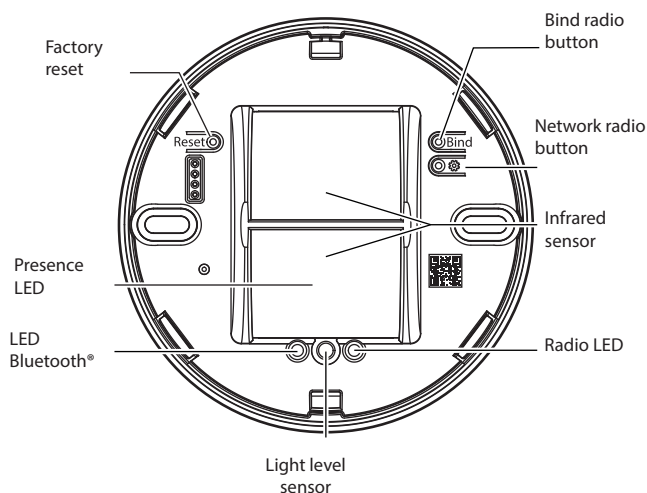


## 6. MOUNTING

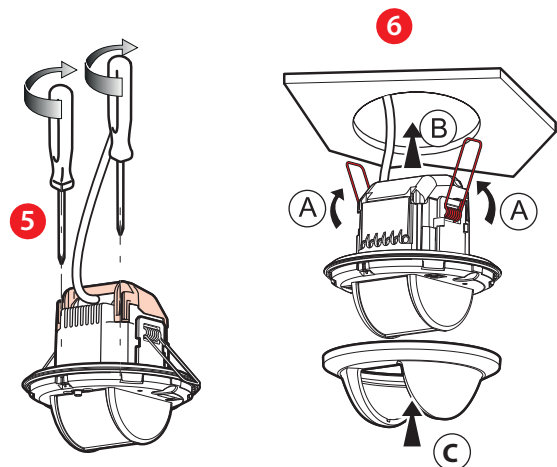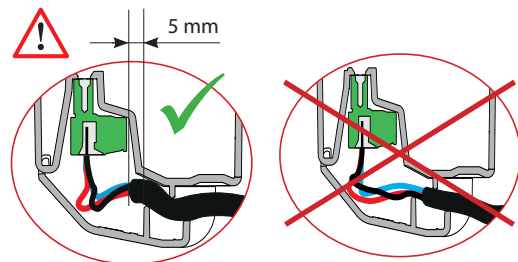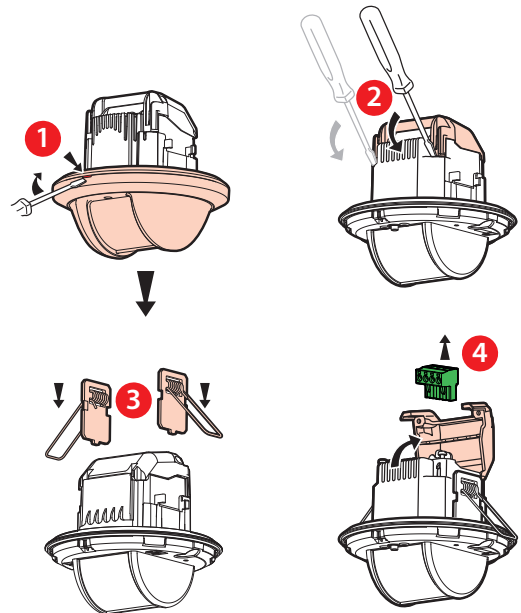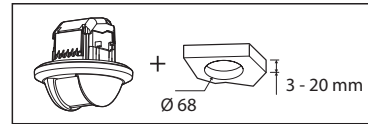

Mounting and wiring must be done with the power off. Please follow the **Safety Instructions** exactly.

7. WIRING

■ 7.1 Standalone solution

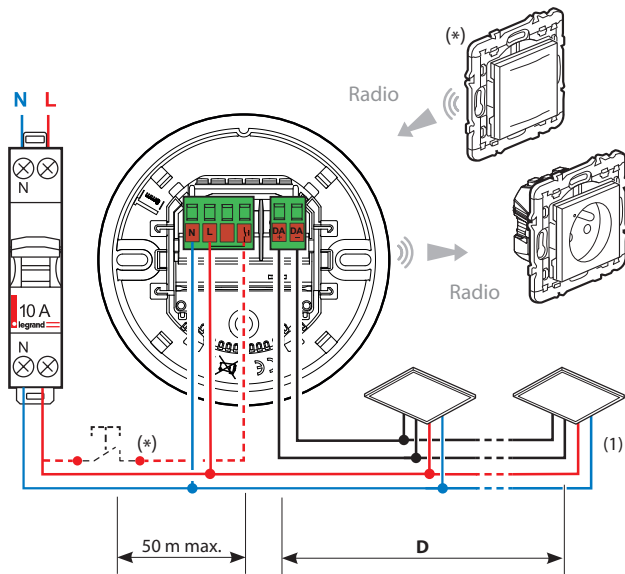

(\*) This product can be controlled by:

- A wireless batteryless switch (ON/OFF without dimming)
- Or
- A wired push-button (ON/OFF with dimming)
- And it can control a 2P+E power outlet (wirelessly)

**Note:**

The maximum distance between the wired push-button and the auxiliary input is 50 m.

• **Note:**

To pair a control point and/or a power outlet in standalone mode, please refer to the description of procedures in the **LIGHT UP technical guide**.

(1) Recommended cable cross-section for the 1.5 mm<sup>2</sup> DALI output.

**DALI BUS**

D	
≤ 100 m	0.5 mm <sup>2</sup>
≤ 150 m	0.75 mm <sup>2</sup>
≤ 300 m	1.5 mm <sup>2</sup>

(\*)


Option of combining with a wireless batteryless lighting switch (maximum 2 per sensor)  
Cat. Nos. 0 677 23L/73L/79L, 0 770 53L, 6 000 83L, 5 742 10/39/55, 5 743 24, 7 418 13L/43L/73L  
and a connected power outlet (maximum 5 per sensor)  
Cat. Nos. 0 677 25A/75A, 0 648 95A, 0 777 11LA, 6 003 91A, 5 742 56/57/58/59, 7 419 11/41/71  
as described in the **LIGHT UP Guide** procedures.

**CAUTION:**

The sensor provides the DALI BUS power supply.  
**Do Not** connect 2 sensors to the same DALI BUS.

■ 7.2 Master/Slave

By default the product is configured as **Master**. To change it to **Slave**, refer to the description in the **LIGHT UP technical guide**.

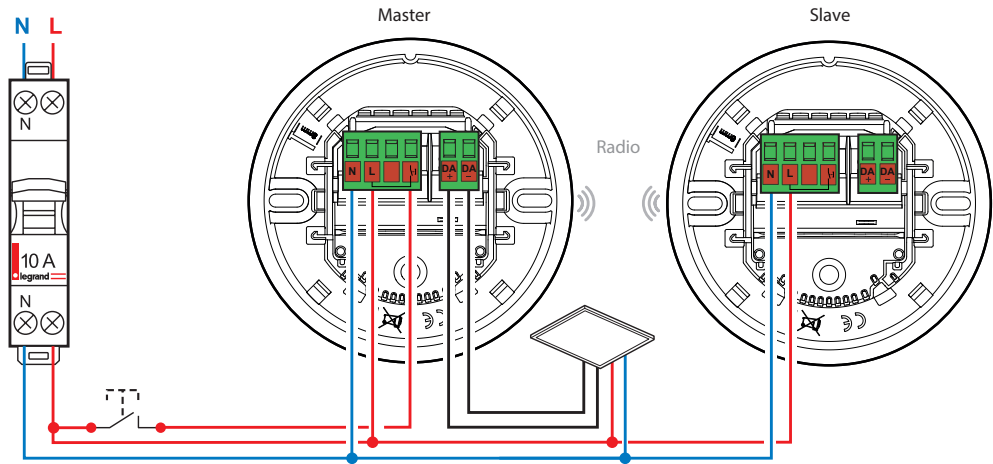


The master can be paired with a maximum of 5 sensors configured as slaves.  
The slave can extend the detection zone. No loads should be paired with it.  
If being used in "**Master/Slave**" mode, the push-button should only be connected to the "Master" sensor.




Sensor 0 485 56 is configured to control dimmable DALI ECGs; it can be paired with DALI actuators (ON/OFF). To do this, use the "**LEGRAND CLOSE UP**" app on your smartphone to change the type of load used, in this case "**Non Dimmable**".

8. INSTALLATION


■ 8.1 Positioning the sensor

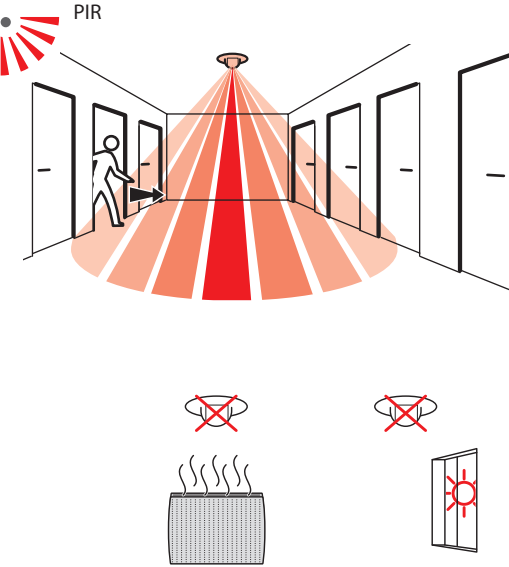

■ 8.2 Recommended light exposure

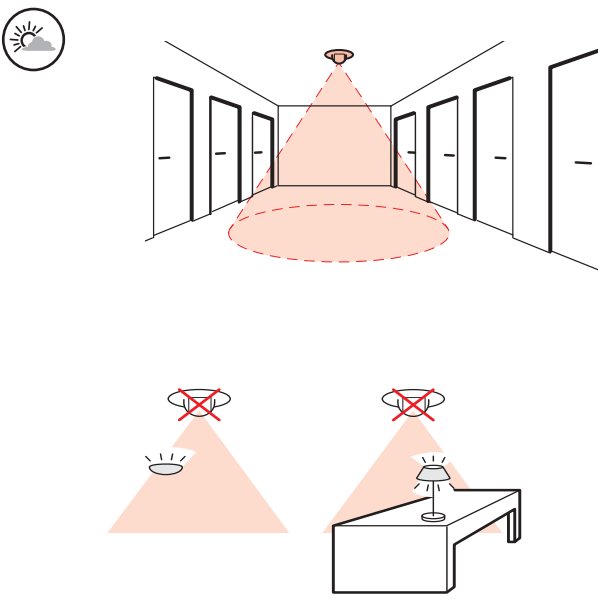


■ 8.3 Installation restriction

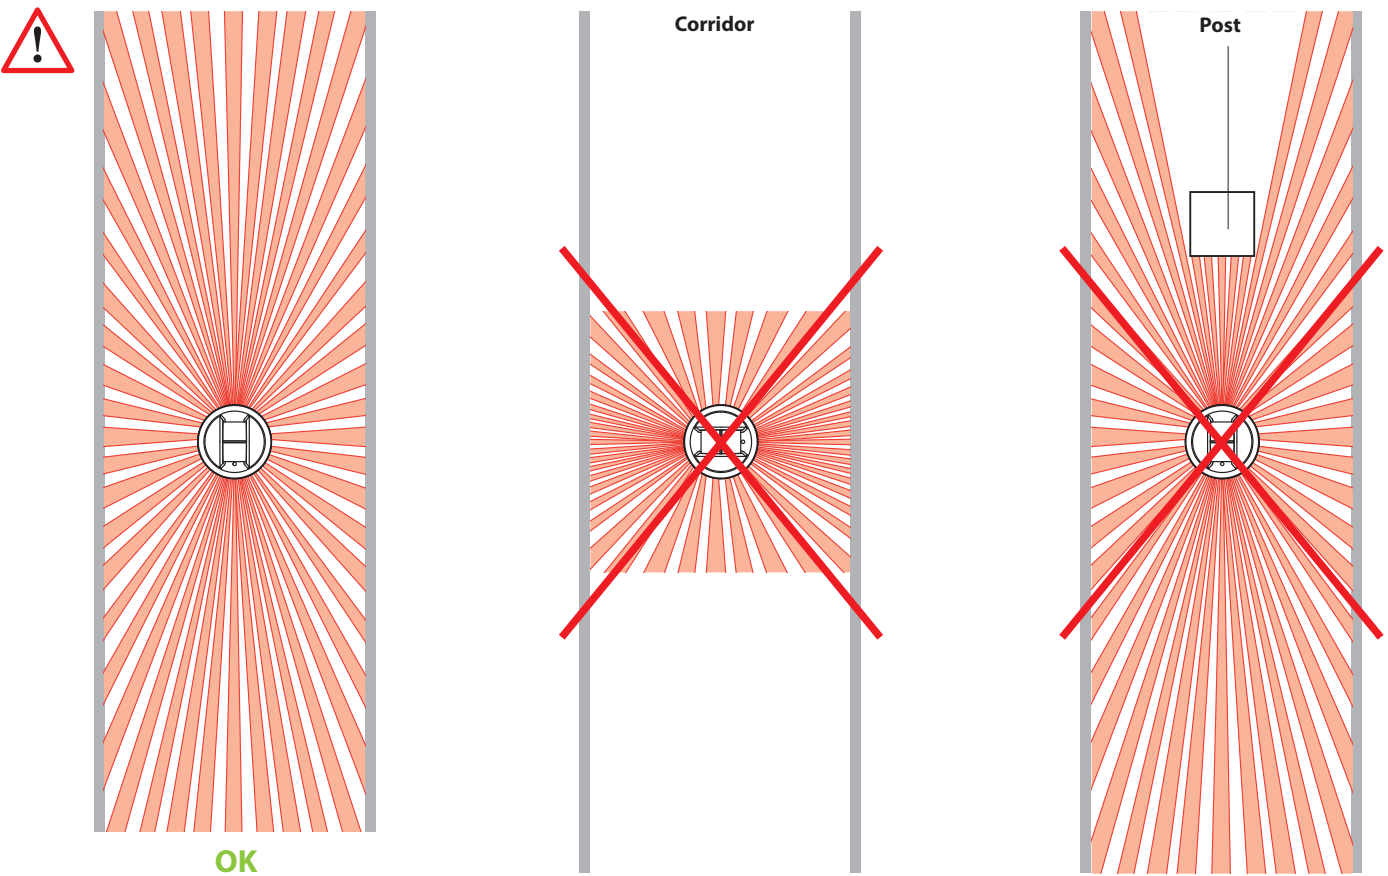


## 9. PERFORMANCE

### ■ 9.1 Sensing model

#### Axial approach

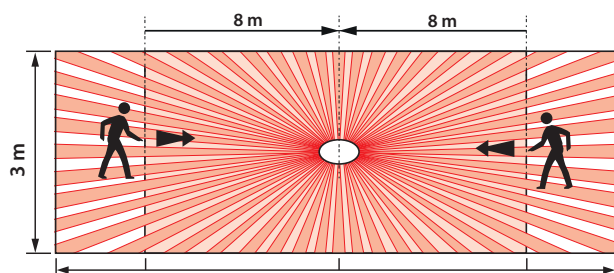


#### Transverse approach

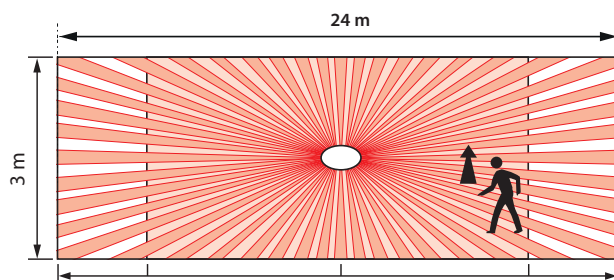


### ■ 9.2 Maximum sensitivity

#### Height


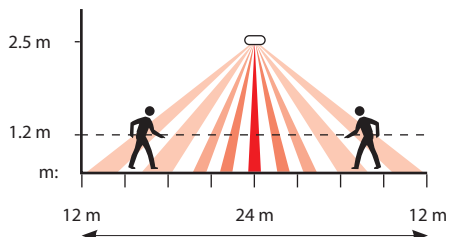


## 10. MODES

### ■ 10.1 Auto ON/OFF



### ■ 10.2 Manual ON/Auto OFF



## 11. LEGRAND CLOSE UP APP

The sensor functions are controlled by a number of parameters which can be changed or programmed with the **Legrand CLOSE UP** app.

**LEGRAND CLOSE UP** can be used to view and change all the sensor parameters.

Exchanges between the sensor and the phone are via Bluetooth®.

#### Note:

Refer to the **LIGHT UP technical guide** to find the description of procedures for setting up LIGHT UP products.


Available to download from:



or



Direct access





## 12. SETTINGS WITH CLOSE UP

### 12.1 Different product states

**Warm-up:** Initial state after switch-on, the lights are on, the presence sensor is in the preheating phase for 80 seconds. The presence LED is lit.


**Initial:** The product is ready to control lighting based on its parameters and its sensor measurements.

**Test:** Enabled by the installer or the expert, this state is used to check the presence sensor and its coverage.

The settings are overridden except for PIR sensitivity, every time presence is detected the light comes on for 5 s.

This test is available for 10 minutes if specifically requested.

### 12.2 Detection settings

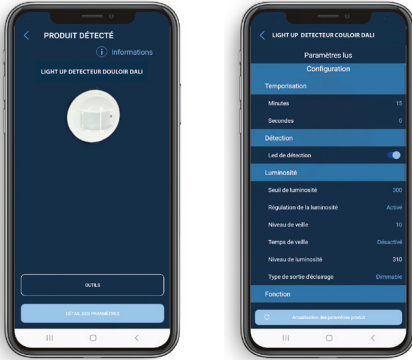

Sensor settings		Default value	Modifiable parameters
Time delay	Minutes	10	0 to 59 min.
	Seconds	0	15 to 59 s.
Detection	PIR sensitivity	High	Low, Medium, High, Very high
	Detection LED	Enabled	Disabled, Enabled
	Daylight setpoint	150 lux	5 to 1275 lux
	Light level regulation	Enabled	Disabled, Enabled
	Fade level	10	10 to 100
Light level	Standby time	Disabled	Disabled
			5 sec.
			10 sec.
			20 sec.
			30 sec.
			1 min.
			5 min.
			10 min.
			15 min.
			30 min.
			60 min.
			No limit
	Light level	Read-only parameter	
	DALI light level offset	25%	0 to 100%
	Load type	Dimmable	Dimmable/Non Dimmable
Function	Mode	Walkthrough	Auto ON/OFF
			Walkthrough
			Manual ON/Auto Off
	Restart <sup>(*)</sup>	Enabled	Disabled, Enabled
Advanced mode	Regulation speed	At least 10 minutes	At least 5 minutes
			At least 10 minutes
			At least 15 minutes
			At least 20 minutes
			At least 25 minutes
	Product version	Read-only parameters	
	Zigbee IEEE		

(\*) Parameter only accessible if Mode → Manual ON/Auto OFF

All these parameters can be viewed and/or modified from the **CLOSE UP** app. The procedures for using the app can be viewed in the **LIGHT UP Technical Guide**.

## 12. SETTINGS WITH CLOSE UP (continued)

### 12.2 Detection settings (continued)

**Time delay:** Length of time the load remains on after detection.

**Sensitivity:** Detection range setting.

**Detection LED:** Comes on for 80 s when the product is commissioned. Comes on for 1 s to indicate presence detection.

**Daylight setpoint:** Value at which the load switches on if the light level is less than the setting and goes off if it is above this setpoint.

**Light contribution:** Quantity of additional lux brought in by the load being switched on. When the **Light contribution** parameter is set to 0 the sensor automatically calculates the light contribution.

**Regulation:** Automatic switch-off of the load 10 minutes after the daylight setpoint is exceeded. If the level of light is below the daylight setpoint, the load is activated automatically after 20 seconds.

**Fade level:** Warns of switch-off by lowering the daylight setpoint before switch-off.

**Standby time:** Used to adjust the switch-off warning duration.

**NB:** Choosing an unlimited duration allows there to be a minimum light level when no presence is detected.

### Light level:

Light level value measured by the product.

### 12.3 Modes:

#### Auto on/Auto off mode:

The lighting switches on automatically:

- On detection of presence if the natural light level is insufficient.

The lighting switches off automatically:

- When no presence is detected and at the end of the set time delay.
- Or if the natural light level is sufficient (regulation enabled).

Any new detection triggers an automatic switch-on if there is insufficient light.

#### Walkthrough mode:

- If no presence is detected in the 20 seconds following an initial detection, the device will switch off the load after 3 minutes.

- If another movement is detected in the 3 minutes following initial detection, the device will switch off the load at the end of the set time delay.

#### Manual on/Auto off mode:

The lighting is switched on by a manual control, but switches off automatically:

- When no presence is detected and at the end of the set time delay.

After switch-off, if another movement is detected within a 30-second period, the lighting switches on automatically.

### 12.4 Advanced mode

#### Restart:

Function allowing automatic switch-on of the product after a period of 30 seconds following the load being switched off.

After switch-off, any new detection within a 30-second period triggers an automatic switch-on.


After more than 30 seconds the device must be switched on manually. Function only available in Manual ON/Auto OFF.

#### Regulation speed:

Used to extend or reduce the load reaction time based on the light level measurement and user setpoint.

## 12. SETTINGS WITH CLOSE UP (continued)

## ■ 12.5 Access to tools

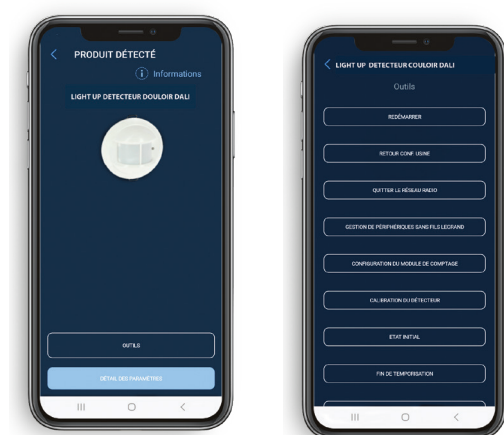

**Reboot:** Used to reboot the product in the event of a fault.

**Factory reset:** By pressing the app button or pressing the Reset button for 10 s. On the Reset button.

The radio LED flashes red for 5 s at 2 Hz.

**Results:** The parameters are set to default values. The radio part (link, network table) is cleared. The passwords are reset to their factory value.

**Exit the network:** Remove the product from the Radio network

**Manage wireless peripherals:** Used to add or delete switches and/or power outlets.

**Calibrate light level detector:** Used to determine 2 reference values (lux), light on/shutters closed and light off/shutters open. After pressing this button, follow the described procedure.

**Test mode:** Switch dedicated to checking the product behaviour, mainly used by the installer or expert.

- **Return to initial state:** This switch is used to put the product in heating mode, which can help the installer check several key points (daylight setpoint, detection, automation device).


- **End of time delay:** Clears the current delay.

- **Walk test:** Useful for testing the presence sensor's field of vision. This mode is used to override the settings except for PIR sensitivity for 10 minutes. Each detection lights up the presence indicator (if the dedicated parameter is enabled) and switches on the lighting for 5 seconds. After these 5 seconds, if no presence is detected, the light goes out, otherwise the 5-second delay is refreshed.


**Master/Slave:** The Master controls the load(s). The slave is used to extend the detection zone; it does not control the load directly. By default the sensor is set to Master mode.





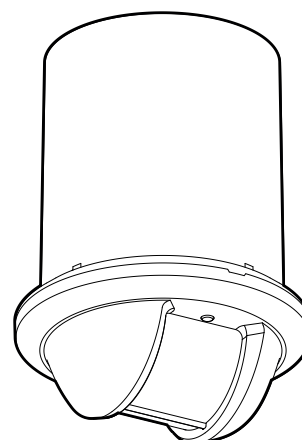

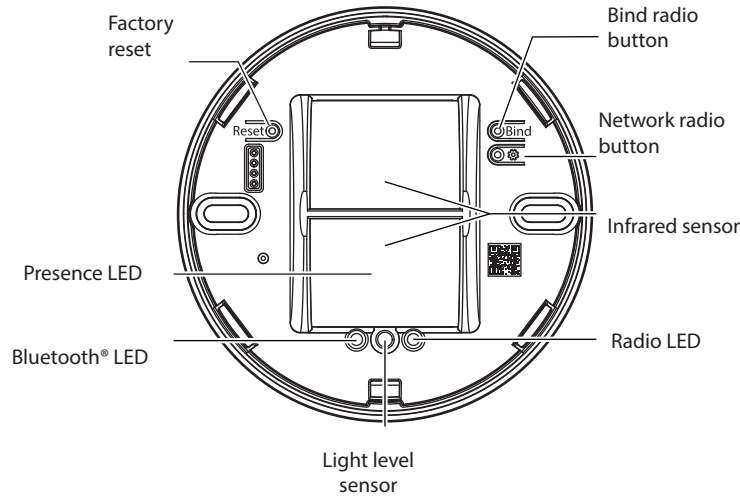


## 13. SURFACE-MOUNTING ACCESSORY

Surface mounting with accessory Cat. No. 0 485 80, follow the instructions in the manual supplied with the accessory.



14. DESCRIPTION OF BUTTONS AND LEDs



<b>Network radio button</b>	< 0.5 s Join a network/Open and close network > 5 s Radio reset	
<b>Bind button</b>	< 0.5 s Network creation/Initiator binding > 5 s Target Binding	
<b>Reset button</b>	< 0.5 s Reboot > 5 s Factory reset	
<b>Radio LED</b>	Failure of network creation, joining a network or binding. Product reset ( <i>red flash</i> )	Red flash 
	The product is in a radio network, the network is open.	Steady magenta 
	After the <b>Network</b> button is pressed: attempt to join a radio network. It changes to steady magenta if the operation was successful. If not, the LED flashes red 5 times.	Flashing magenta 
	<b>Binding</b> procedure in progress	Flashing blue 
	Updating	Flashing cyan 
	Product anomaly, reboots 15 s after the anomaly	Steady white 
	Product start-up	Steady yellow 
<b>Presence LED</b>	In pre-heating state (commissioning) the LED stays on for 80 s. Each time movement is detected, the LED comes on for 1 s.	Steady green 
<b>Bluetooth® LED</b>	Is on when the product is paired with a smartphone.	Steady blue 



15. STANDARDS

Installation standards: NFC 15-100

Product standards: EN 50428

**LVD** "Low Voltage Directives":

- Directive → 2014/35/EU
- Standard → NF EN IEC 60669-2-1:2022

**EMC** "Electromagnetic compatibility":

- Directive → 2014/53/EU
- Standard → NF EN IEC 60669-2-1:2022  
ETSI EN 301489-1  
ETSI EN 301489-17

**RED** (radio equipment):

- Directive → 2014/53/EU
- Standard → ETSI EN 300 328 v2.2.2:2020  
IEC62311:2020

**RoHS** (Restriction of Hazardous Substances):

- Directive → 2011/65/EU  
2015/863/EU

**EC directives:**

- European Directive 2002/96/EC:  
WEEE (Waste Electrical and Electronic Equipment)
- EC Directive 2002/95/EC:  
RoHS (Restriction of Hazardous Substances)

16. CARE

Keep the lens clean.

Clean the surface with a cloth.

**Do not use:** acetone, tar-removing cleaning agents or trichloroethylene.

Resistant to the following products: - Hexane (EN 60669-1)

- Methylated spirit
- Soapy water
- Diluted ammonia
- Bleach diluted to 10%
- Window cleaning products

**Caution:**

Always test before using other special cleaning products.

17. TROUBLESHOOTING

Problem	Causes	Solutions
The lighting stays on when there is no-one present	Sources of interference such as draughts, vibration or radiators may cause nuisance tripping	1- Reduce the sensitivity level 2- If the interference still continues, move the sensor away from sources of interference
The lighting does not switch off during the day when there is an adequate natural light level	Regulation function inactive Daylight setpoint too high Too much light provided	Enable the <b>Regulation</b> function Reduce the light level threshold Check that the sensor is positioned correctly in relation to the window Decrease the power of the luminaires
The lighting switches off when there are people present and the natural light level is not adequate (darkness)	Time delay too short Detection sensitivity too low Daylight setpoint too low	Increase the <b>Time delay</b> 10 to 1 minutes is recommended for work areas Increase the <b>Sensitivity</b> Move the sensor closer to the work area Increase the <b>Threshold</b>